



**SIDE ELEVATION**

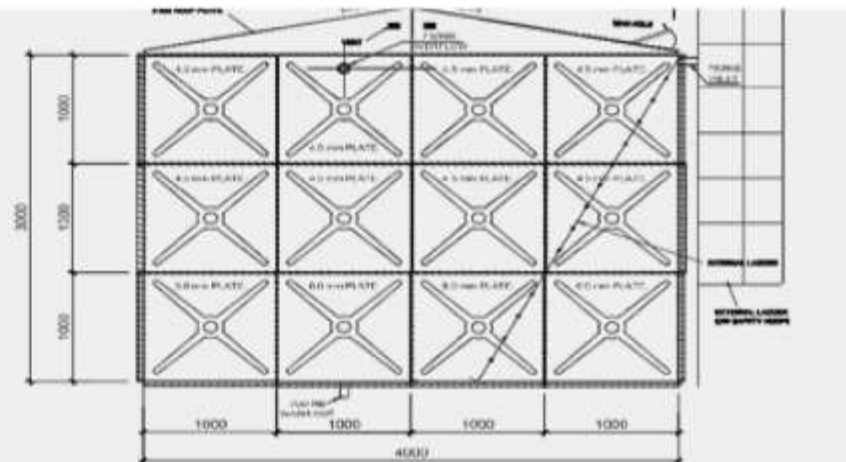

**END ELEVATION**

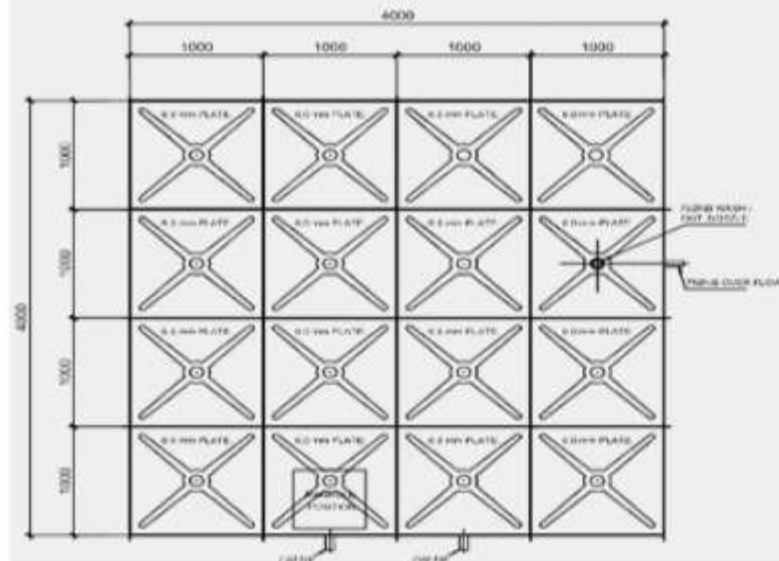

**GENERAL NOTES:**

- 01 ALL STRUCTURAL STEELWORK TO BE GRADE 43C
- 02 STEELWORK TO BE WIRE BRUSHED PRIOR TO FINISHING APPLICATION
- 03 INSIDE TANK ONE COAT OF PRIMER & TWO COATS OF NON TOXIC BITUMINOUS PAINT  
OUTSIDE TANK ONE COAT OF PRIMER & ONE COAT OF SILVER ALUMINUM PAINT
- 04 ALL SHOP WELDS TO BE SPURFLET WELDS UNLESS OTHERWISE NOTED
- 05 ALL SECTION SIZES ARE AS SPECIFIED ON DRAWING UNLESS OTHERWISE NOTED.
- 06 BOLTS ARE GALVANIZED GRADE 8.8

All Dimensions in mm unless otherwise specified  
 All works to be carried out in accordance with local authority regulations  
 Use figured dimensions only do not scale from the drawing  
 All reinforced concrete works is to be in accordance with S.E's details.  
 LEVELS in meters  
 Ground to be well tested during excavations.

Proposed 50 cubic metres tank on a 10 metres high tower in SKUMA village in Ngaremara .

